

FINISHED GRADE  
OR SUBGRADE

COMPACTED BACKFILL, SEE DETAIL SS7

SPECIAL PRECAUTIONS TO  
PROTECT PIPE TO THIS LEVEL

3" MIN. WIDTH FLOURESCENT  
ORANGE IDENTIFICATION TAPE  
"NON-POTABLE WASTEWATER"  
TO RUN CONTINUOUS WITH PIPE


PIPE ZONE BACKFILL, SEE  
DETAIL SS7

TRACER WIRE FOR PVC PIPE

DUCTILE IRON, HDPE  
OR PVC SEWER PIPE

FOUNDATION GRAVEL  
AS REQUIRED

FIRM AND UN-YIELDING SUB-GRADE

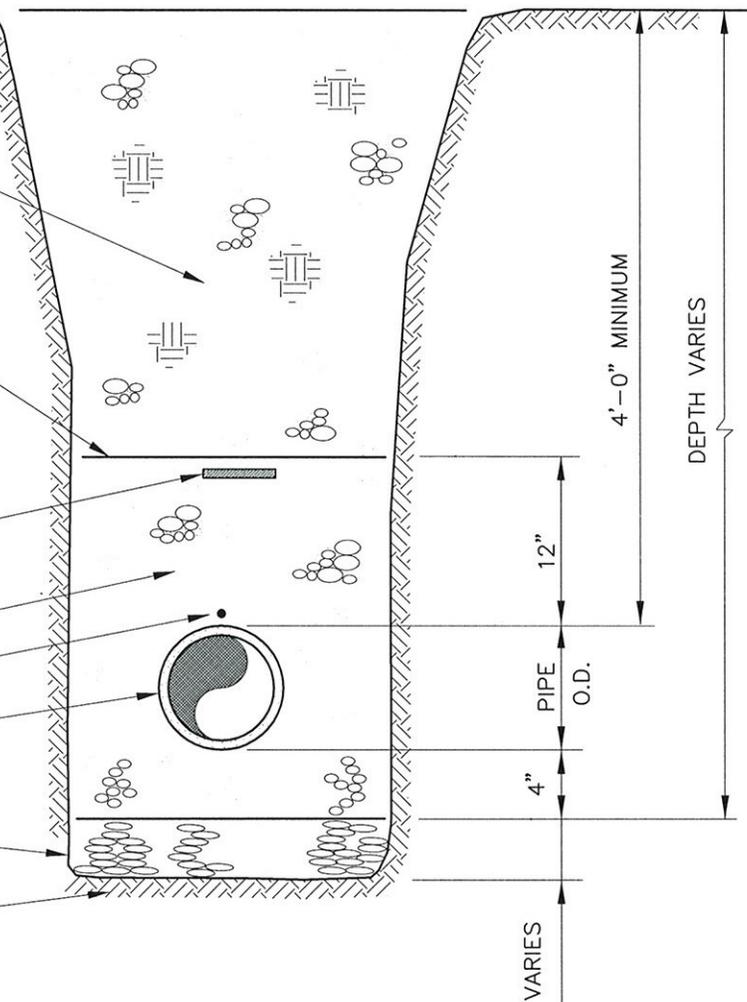

**NOTE:**

TRACER WIRE (10 GA) SHALL BE TERMINATED IN A  
MANHOLE, VAULT, OR OTHER APPROVED LOCATION  
ON A TERMINAL BLOCK WITHIN 18" OF THE LID OR  
RIM OF THE STRUCTURE.

Approved:

June 17, 2005

City Engineer

Date

SANITARY SEWER STANDARD DETAIL



Dwg No:

**SS8**

**PRESSURE LINE AND FORCE  
MAIN TRENCH SECTION**