
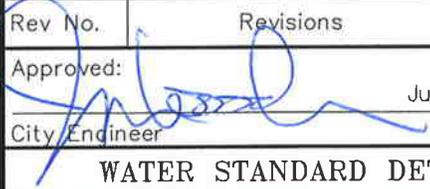


NOTES:

1. ALL MATERIALS AND FITTINGS SHALL BE AS SPECIFIED.
2. THE WATER METER SHALL BE LOCATED ADJACENT TO THE RIGHT-OF-WAY LINE AS DIRECTED BY THE CITY.
3. FOR A 1 1/2" WATER SERVICE A 1 1/2" FORD BALL VALVE SHALL BE USED.
4. METERS SHALL BE INSTALLED BY THE CITY OF BONNEY LAKE.
5. PIPE MATERIAL SHALL BE HIGH MOLECULAR POLYETHYLENE SDR7 (200 PSI).
6. INDIVIDUAL PRESSURE REDUCING VALVE (WASHINGTON STATE DEPARTMENT OF HEALTH APPROVED) IS REQUIRED.
7. ALL BRASS SHALL BE DOMESTIC.

3	Revised Note 4.	8/3/13
2	Specified Domestic Brass	3/7/12
1	Added PRV Requirement	8/27/09
Rev No.	Revisions	Date

Approved:  June 17, 2005
 City Engineer Date
WATER STANDARD DETAIL



Dwg No: **W11**
1-1/2" AND 2" WATER SERVICE