

FINISHED GRADE
OR SUB-GRADE

COMPACTED BACKFILL CONSISTING
OF SUITABLE EXCAVATED MATERIAL
OR SELECT BORROW (IN
ACCORDANCE W/WSDOT
9-03.14(2)), OR CRUSHED ROCK
AS REQUIRED BY THE CITY


SPECIAL PRECAUTIONS TO
PROTECT PIPE TO THIS LEVEL

HAND-PLACED, COMPACTED
SELECT BACKFILL (SEE NOTE 1)

DUCTILE IRON PIPE

BEDDING (AS DIRECTED BY
THE CITY). SEE NOTE 2


FOUNDATION MATERIAL
AS REQUIRED

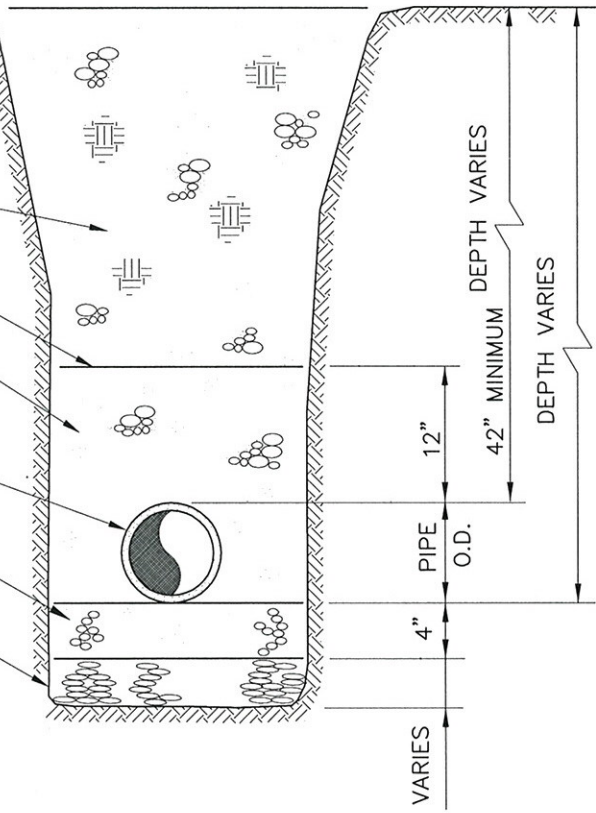

NOTES:

1. TRENCH SHALL BE BACKFILLED AND COMPACTED IN ACCORDANCE W/ WSDOT 7-09.3(10) & (11) OR AS DIRECTED BY THE CITY.
2. BEDDING (IF REQUIRED BY THE CITY), SHALL CONFORM TO WSDOT 7-09.3(9).

Approved:  June 17, 2005
 City Engineer Date
WATER STANDARD DETAIL



Dwg No: **W2**
**WATER MAIN
 TRENCH SECTION**